



# EVPU®

NOTIFIED BODY No. 1293

## CERTIFICATE OF CONSTANCY OF PERFORMANCE

No. 1293 – CPR – 0422 Rev.1

In compliance with *Regulation (EU) No 305/2011 of the European Parliament and of the Council of March 9<sup>th</sup>, 2011* (the Construction products Regulation or CPR), this certificate applies to the construction product

**Addressable indoor siren TFIS01**



For specifications see Annex to this certificate

placed on the market under the name or trade mark of

**TECNOALARM s.r.l.,  
Via Cirie 38, 10099 San Mauro - Torino, Italy**

and produced in the manufacturing plant

**TECNOALARM s.r.l.,  
Strada del Cascinotto 139/54, 10154 Torino, Italy**

This certificate attests that all provisions concerning the assessment and verification of constancy of performance described in Annex ZA of the standard(s)

**EN 54-3: 2001, EN 54-3:2001/A1:2002, EN 54-3:2001/A2:2006  
EN 54-17:2005, EN 54-17:2005/AC:2007**

under system 1 for the performance set out in this certificate are applied and that the factory production control conducted by the manufacturer is assessed to ensure the

**constancy of performance of the construction product.**

This certificate was first issued on August 14, 2014 and will remain valid as long as neither the harmonised standard, the construction product, the AVCP methods nor the manufacturing conditions in the plant are modified significantly, unless suspended or withdrawn by the notified product certification body.

Nová Dubnica, February 17<sup>th</sup>, 2026



**Róbert Janíga**  
Head of NB No. 1293

055747

EVPU a.s., NO 1293, AO SK08, Trenčianska 19, SK 018 51 Nová Dubnica, Slovak Republic, [www.evpu.sk](http://www.evpu.sk)  
Identification number: 31 562 507  
Page 1 / 2 F COCV 7.7.12 Rev.1

## Annex to Certificate No. 1293 - CPR – 0422 Rev. 1 from February 17<sup>th</sup>, 2026

### Technical Specifications

The TFIS01 siren can be connected to one of the loops of a TFA series fire alarm panel from Tecnofire. The electronic board of the siren is equipped with a loop isolator which, in case of failure, disconnects the siren from the loop in order to safeguard the correct functioning of the devices connected downstream and upstream.

The signaling mode is programmed in the control panel menu. It can be either optical-acoustic or only acoustic.

The siren can generate 64 different sound types. Two volume levels, high and low, can be set.

### Products parameters:


Essential characteristics	Harmonised technical specifications		Performance
	EN 54-3:2001 EN 54-3:2001/A1:2002 EN 54-3:2001/A2:2006	EN 54-17:2005 EN 54-17: 2005/AC:2007	
Performance under fire conditions	cl. 4.2, 4.3, 5.2, 5.3	cl. 5.2	Pass
Operational reliability	cl. 4.4, 4.5, 4.6, 5.4	cl. 4	Pass
Durability of operational reliability: temperature resistance	cl. 5.5, 5.7, 5.8, 5.9	cl. 5.4, 5.5	Pass
Durability of operational reliability: impact and vibration resistance	cl. 5.12 to 5.15	cl. 5.9 to 5.12	Pass
Durability of operational reliability: humidity resistance	cl. 5.8, 5.9	cl. 5.6, 5.7	Pass
Durability of operational reliability: corrosion resistance	cl. 5.11	cl. 5.8	Pass
Durability of operational reliability: electrical stability	cl. 5.16	cl. 5.3, 5.13	Pass
Durability of operational reliability: resistance to ingress	cl. 5.17	-	Pass


The Addressable indoor siren TFIS01 was also tested in accordance with EN 54-3: 2014 + A1: 2019.

### History of certification:

No.	Certificate No.	Description	Date of issue
1.	1293-CPR-0422	Original CPR certificate issued	August 14 <sup>th</sup> , 2014
2.	1293-CPR-0422 Rev.1	Additional tests according to the standard EN 54-3: 2014 + A1: 2019	February 17 <sup>th</sup> , 2026

Nová Dubnica, February 17<sup>th</sup>, 2026



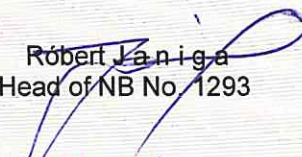  
 Róbert Janiga  
 Head of NB No. 1293